


TYPICAL CORE AND TEE DETAIL
(USE ON EXISTING MAINS)

NOTES: Provide gasketed plug in sanitary sewer connection at R/W line if connection is not to be used immediately.

Employ proper trench safety per latest OSHA Standards.

Bell ends are to be placed upstream.

All PVC pipe shall be ASTM 3034 SDR 35, with 'O' Ring joints per ASTM D-3212

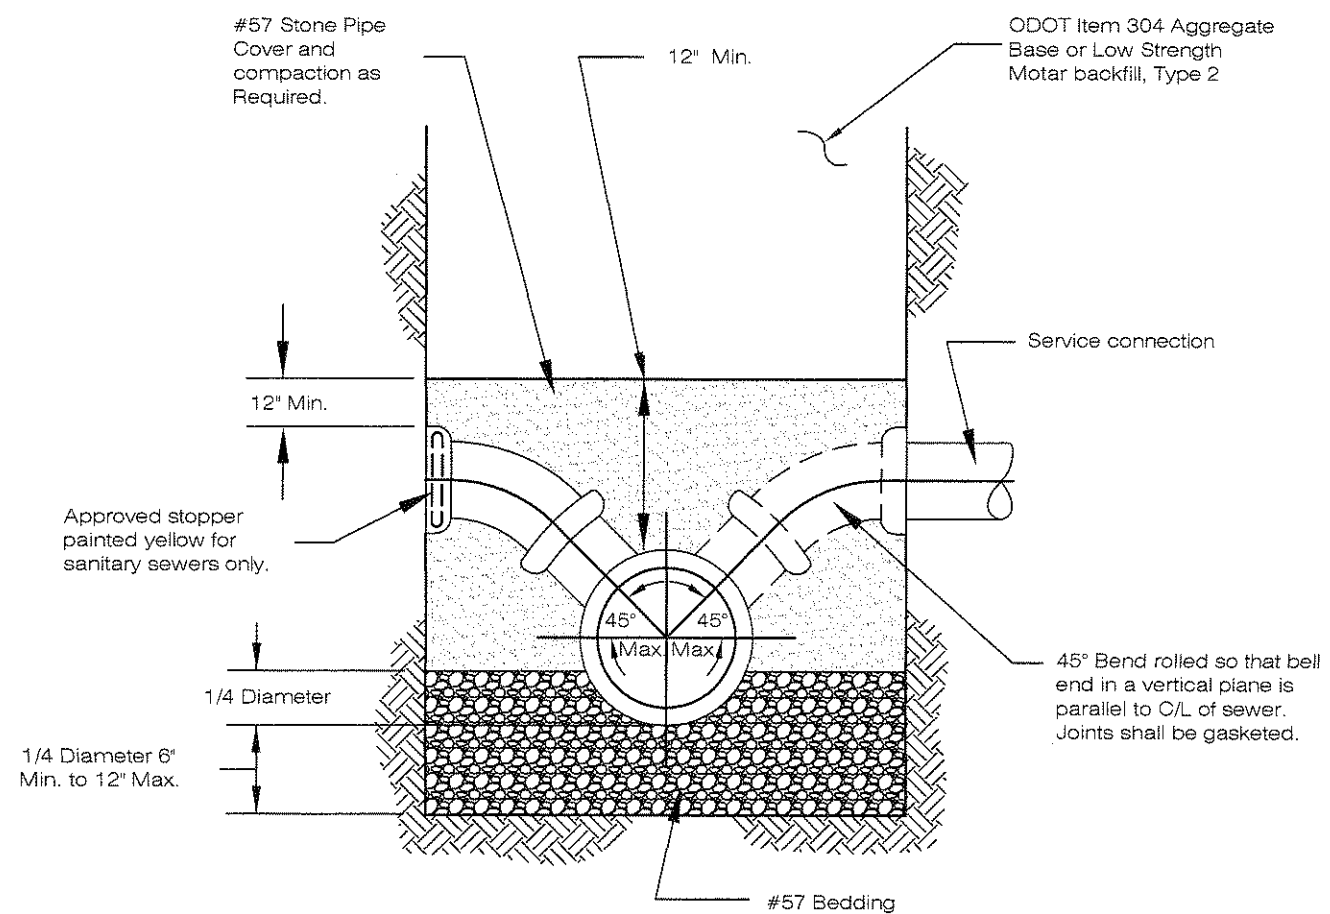

TYPICAL Y-BRANCH DETAIL

REV No.	DATE	BY	DESCRIPTION
CITY OF NORTH RIDGEVILLE, OHIO			
DEPARTMENT OF ENGINEERING			
SANITARY SERVICE			
CONNECTION DETAILS			
SCALE: NOT TO SCALE			SAN-5
DATE: 10/01/08	DRWN BY: JAB/TEB		

Larry Lifflich
CITY OF NORTH RIDGEVILLE, ENGINEER