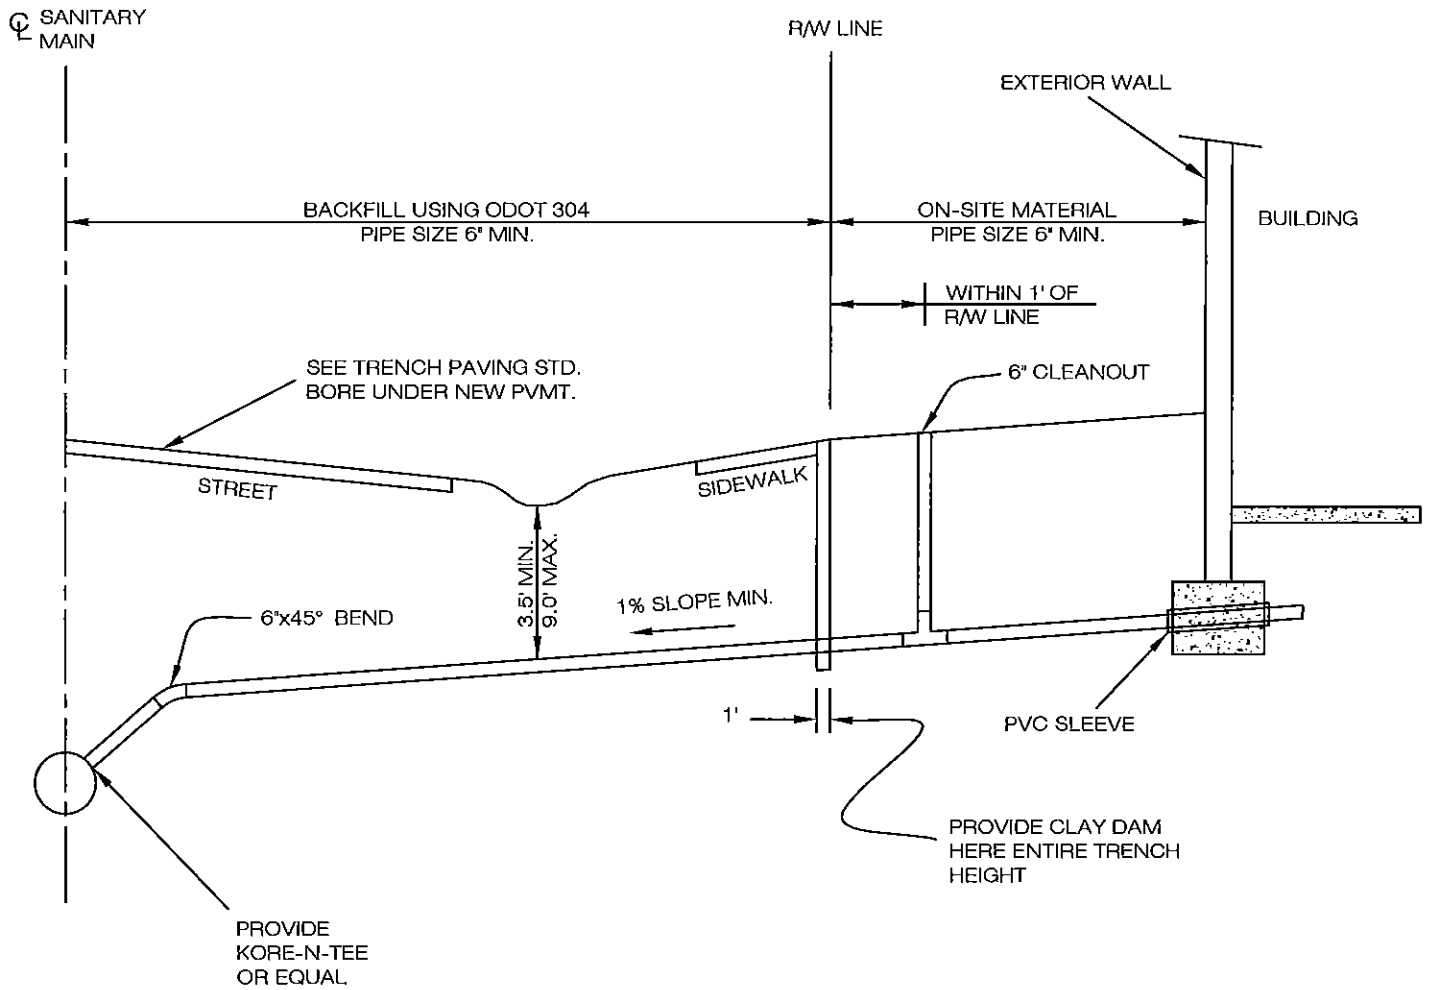

NOTES:
ALL PIPE SHALL BE PVC ASTM D 3034, SDR 35 WITH "O"-RING JOINTS PER ASTM 3212.
BELL ENDS SHALL BE FACED UPSTREAM.
PIPE EMBEDMENT: ODOT #57 4" BELOW PIPE TO 1 FOOT ABOVE TOP OF PIPE, FULL WIDTH OF TRENCH.
BACKFILL: ODOT NO. 304 (ABOVE PIPE EMBEDMENT)
PROVIDE GASKETED PLUG IN SANITARY SEWER CONNECTION AT R/W LINE IF CONNECTION IS NOT TO BE USED IMMEDIATELY.
EMPLOY PROPER TRENCH SAFETY PER LATEST OSHA STANDARDS.

Larry J. Griffith
CITY OF NORTH RIDGEVILLE, ENGINEER

REV No.	DATE	BY	DESCRIPTION

CITY OF NORTH RIDGEVILLE, OHIO
DEPARTMENT OF ENGINEERING

SANITARY SERVICE CONNECTION

SCALE: NOT TO SCALE
DATE: 10/01/08 | DRWN BY: JAB/TEB

SAN-8

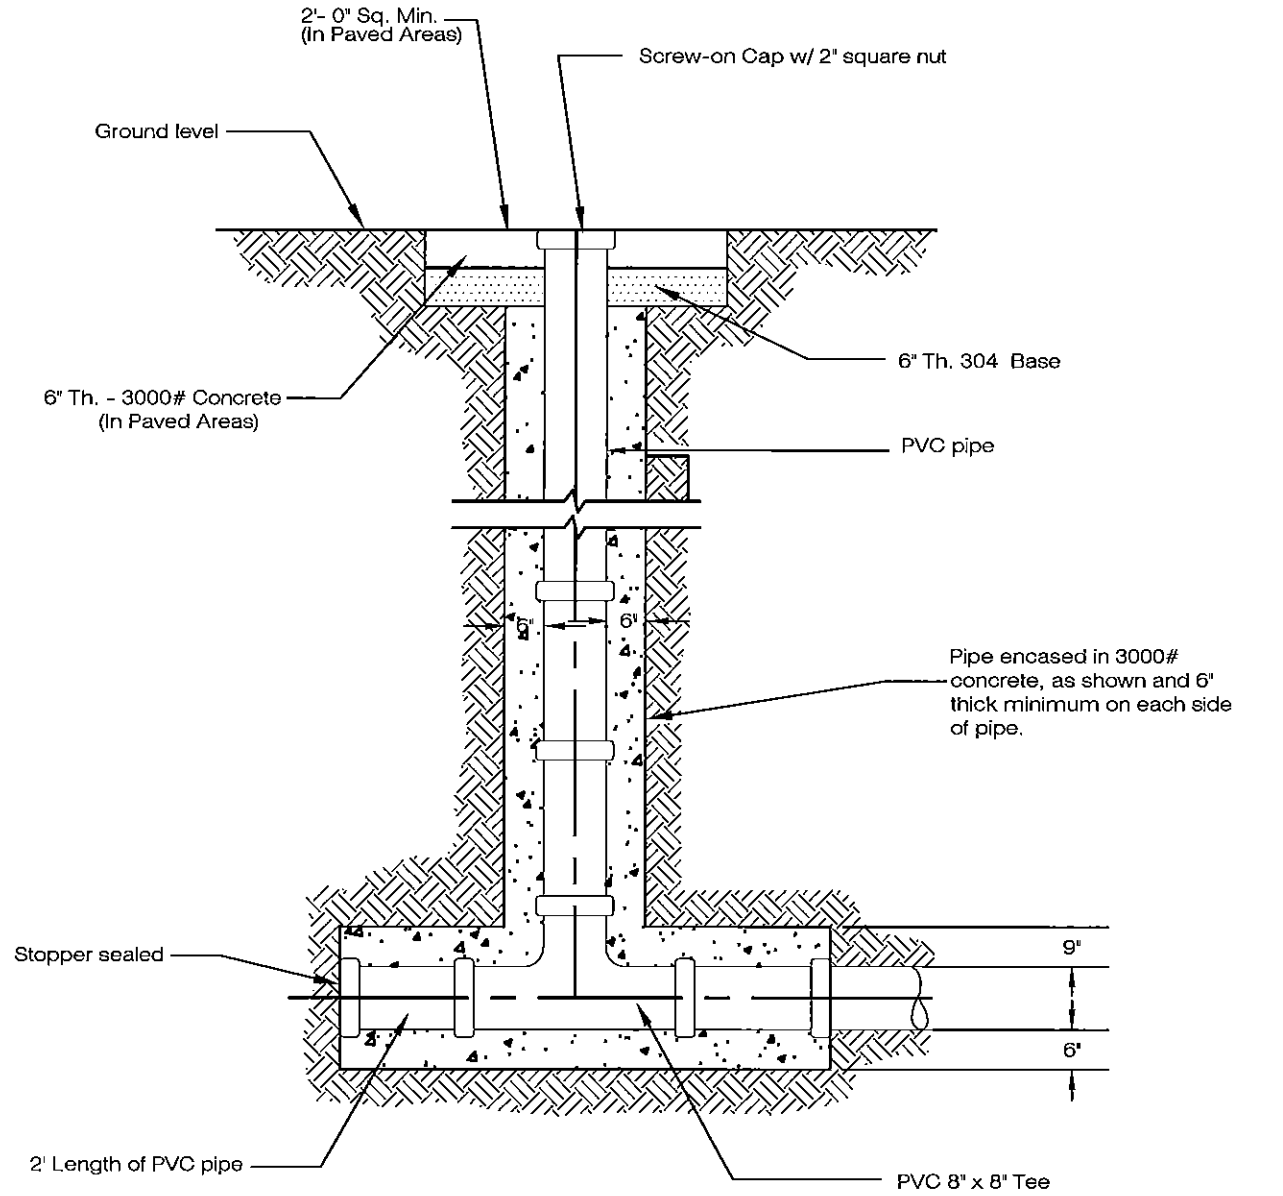

8" Cleanout shall be used for 8" sewers and larger. Smaller size sewers and lamp holes shall have same size pipe.

Larry J. Griffith
CITY OF NORTH RIDGEVILLE, ENGINEER

REV No.	DATE	BY	DESCRIPTION
1	8/12/09	CB	Screw-on Cap

CITY OF NORTH RIDGEVILLE, OHIO
DEPARTMENT OF ENGINEERING

CLEANOUT DETAIL

SCALE: NOT TO SCALE
DATE: 10/01/08 | DRWN BY: JAB/TEB

SAN-9