
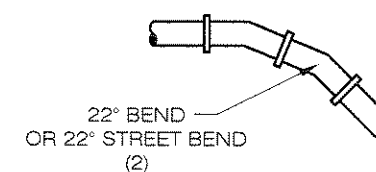
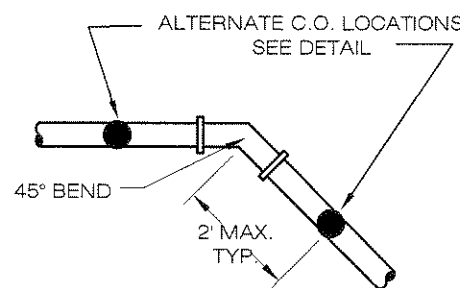
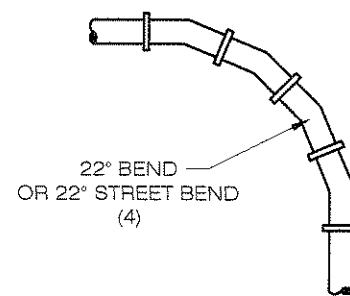


GENERAL NOTES:

- 1) ALL PIPE SHALL BE POLYVINYL CHLORIDE (PVC) SDR 35 ASTM D-3034, UNLESS OTHERWISE DIRECTED.
- 2) ALL BENDS OF 30° OR MORE WILL REQUIRE A CLEANOUT WITHIN (2') TWO FEET OF THE FITTING.
- 3) PIPE BEDDING AND COVER SHALL BE AS PER THE CITY STANDARD FOR TYPICAL TRENCH DETAILS.
- 4) A CLEANOUT IS REQUIRED FOR ALL STORM AND SANITARY SEWER CONNECTIONS AT THE R/W OR THE UTILITY EASEMENT.
- 5) FOR ALL CONNECTIONS LONGER THAN 75' A CLEANOUT WILL BE REQUIRED AT EVERY 75' FOOT INCREMENT OR BEND.
- 6) THE CONTRACTOR SHALL DEWATER THE TRENCH BY PUMP AND SHALL NOT DRAIN GROUND WATER INTO ANY SANITARY SEWER. DISCHARGE INTO STORM SEWER WILL BE PERMITTED ONLY IF METHOD OF DISCHARGE IS APPROVED AND OBSERVED BY THE CITY OF NORTH RIDGEVILLE REPRESENTATIVE.

SEPTIC CONVERSIONS:

- 1) A CLEANOUT IS REQUIRED AT THE FACE OF THE EXISTING STRUCTURE WHERE THE NEW CONNECTION IS ATTACHED TO THE OLD DISCHARGE LINE AND NO CLEANOUT IS ACCESSIBLE IN THE STRUCTURE.
- 2) FERNCO ADAPTERS ARE TO BE USED FOR CAST IRON OR CLAY PIPE WHERE A GASKETED CONNECTION WILL NOT WORK.
- 3) SEPTIC TANK SHALL BE REMOVED OR CRUSHED IN PLACE IN ACCORDANCE WITH THE LORAIN COUNTY GENERAL HEALTH DISTRICT REQUIREMENTS.
- 4) NEW PIPE ALIGNMENT WILL NOT BE PERMITTED TO CROSS OVER THE ABANDONED SEPTIC TANK FOOTPRINT.
- 5) ALL DISCHARGE LINES FROM THE ABANDONED SEPTIC SYSTEMS ARE TO INCLUDE A CLEANOUT AS DIRECTED BY THE ENGINEER.

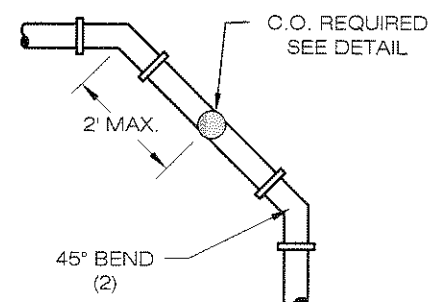

45° BEND

90° BEND

Larry Huff
CITY OF NORTH RIDGEVILLE, ENGINEER

REV No.	DATE	BY	DESCRIPTION
CITY OF NORTH RIDGEVILLE, OHIO DEPARTMENT OF ENGINEERING			
6" STORM & SANITARY SERVICE DETAILS			
SCALE: NOT TO SCALE			SAN-10
DATE: 10/01/08	DRWN BY: JAB/TEB		